

*Application of Oncor Electric Delivery Company LLC to Obtain or Amend a Certificate of Convenience and Necessity for a Proposed CREZ 345 kV Transmission Line in Jack, Parker, and Wise Counties, Texas*

**PUBLIC UTILITY COMMISSION OF TEXAS (PUC) DOCKET NO. 37119**

Oncor Electric Delivery Company LLC provides this notice of intent to amend its Certificate of Convenience and Necessity for the rebuild of an existing 345 kV transmission line located within Jack, Parker, and Wise Counties. The estimated cost of this project is \$53,800,000. A map of the project area with the route of the existing transmission line appears with this notice. A complete copy of the application filed at the Public Utility Commission of Texas and a large scale map of the project area depicting the route of the existing transmission line may be viewed at the following locations:

City Hall  
City of Weatherford  
303 Palo Pinto Street  
Weatherford, TX 76086

Gladys Johnson Ritchie Public Library  
626 West College  
Jacksboro, TX 76458



Persons with questions about the transmission line may contact Travis Besier at 214-486-7333. Persons who wish to intervene in the docket or comment on the applicant's application should mail the original and 10 copies of their requests to intervene or their comments to:

Public Utility Commission of Texas  
Central Records  
Attn: Filing Clerk  
1701 N. Congress Avenue  
P. O. Box 13326  
Austin, Texas 78711-3326

Persons who wish to intervene in the docket must also mail a copy of their request for intervention to all parties in the docket and all persons that have pending motions to intervene, at or before the time the request for intervention is mailed to the PUC.

The deadline for intervention in the docket is **August 17, 2009**, and the PUC should receive a letter from anyone requesting intervention by that date.


The PUC has a brochure titled “Landowners and Transmission Line Cases at the PUC for Competitive Renewable Energy Zone (CREZ) Projects.” Copies of the brochure are available from Travis Besier at 214-486-7333 or may be downloaded from the PUC’s website at [www.puc.state.tx.us](http://www.puc.state.tx.us). To obtain additional information about this docket, you may contact the PUC’s Customer Assistance Hotline at (512) 936-7120 or (888) 782-8477. Hearing-and speech-impaired individuals with text telephones (TTY) may contact the PUC’s Customer Assistance Hotline at (512) 936-7136 or toll free at (800) 735-2989.

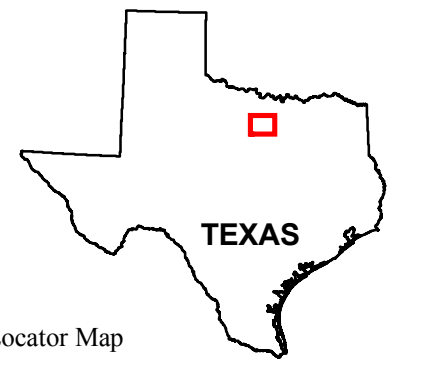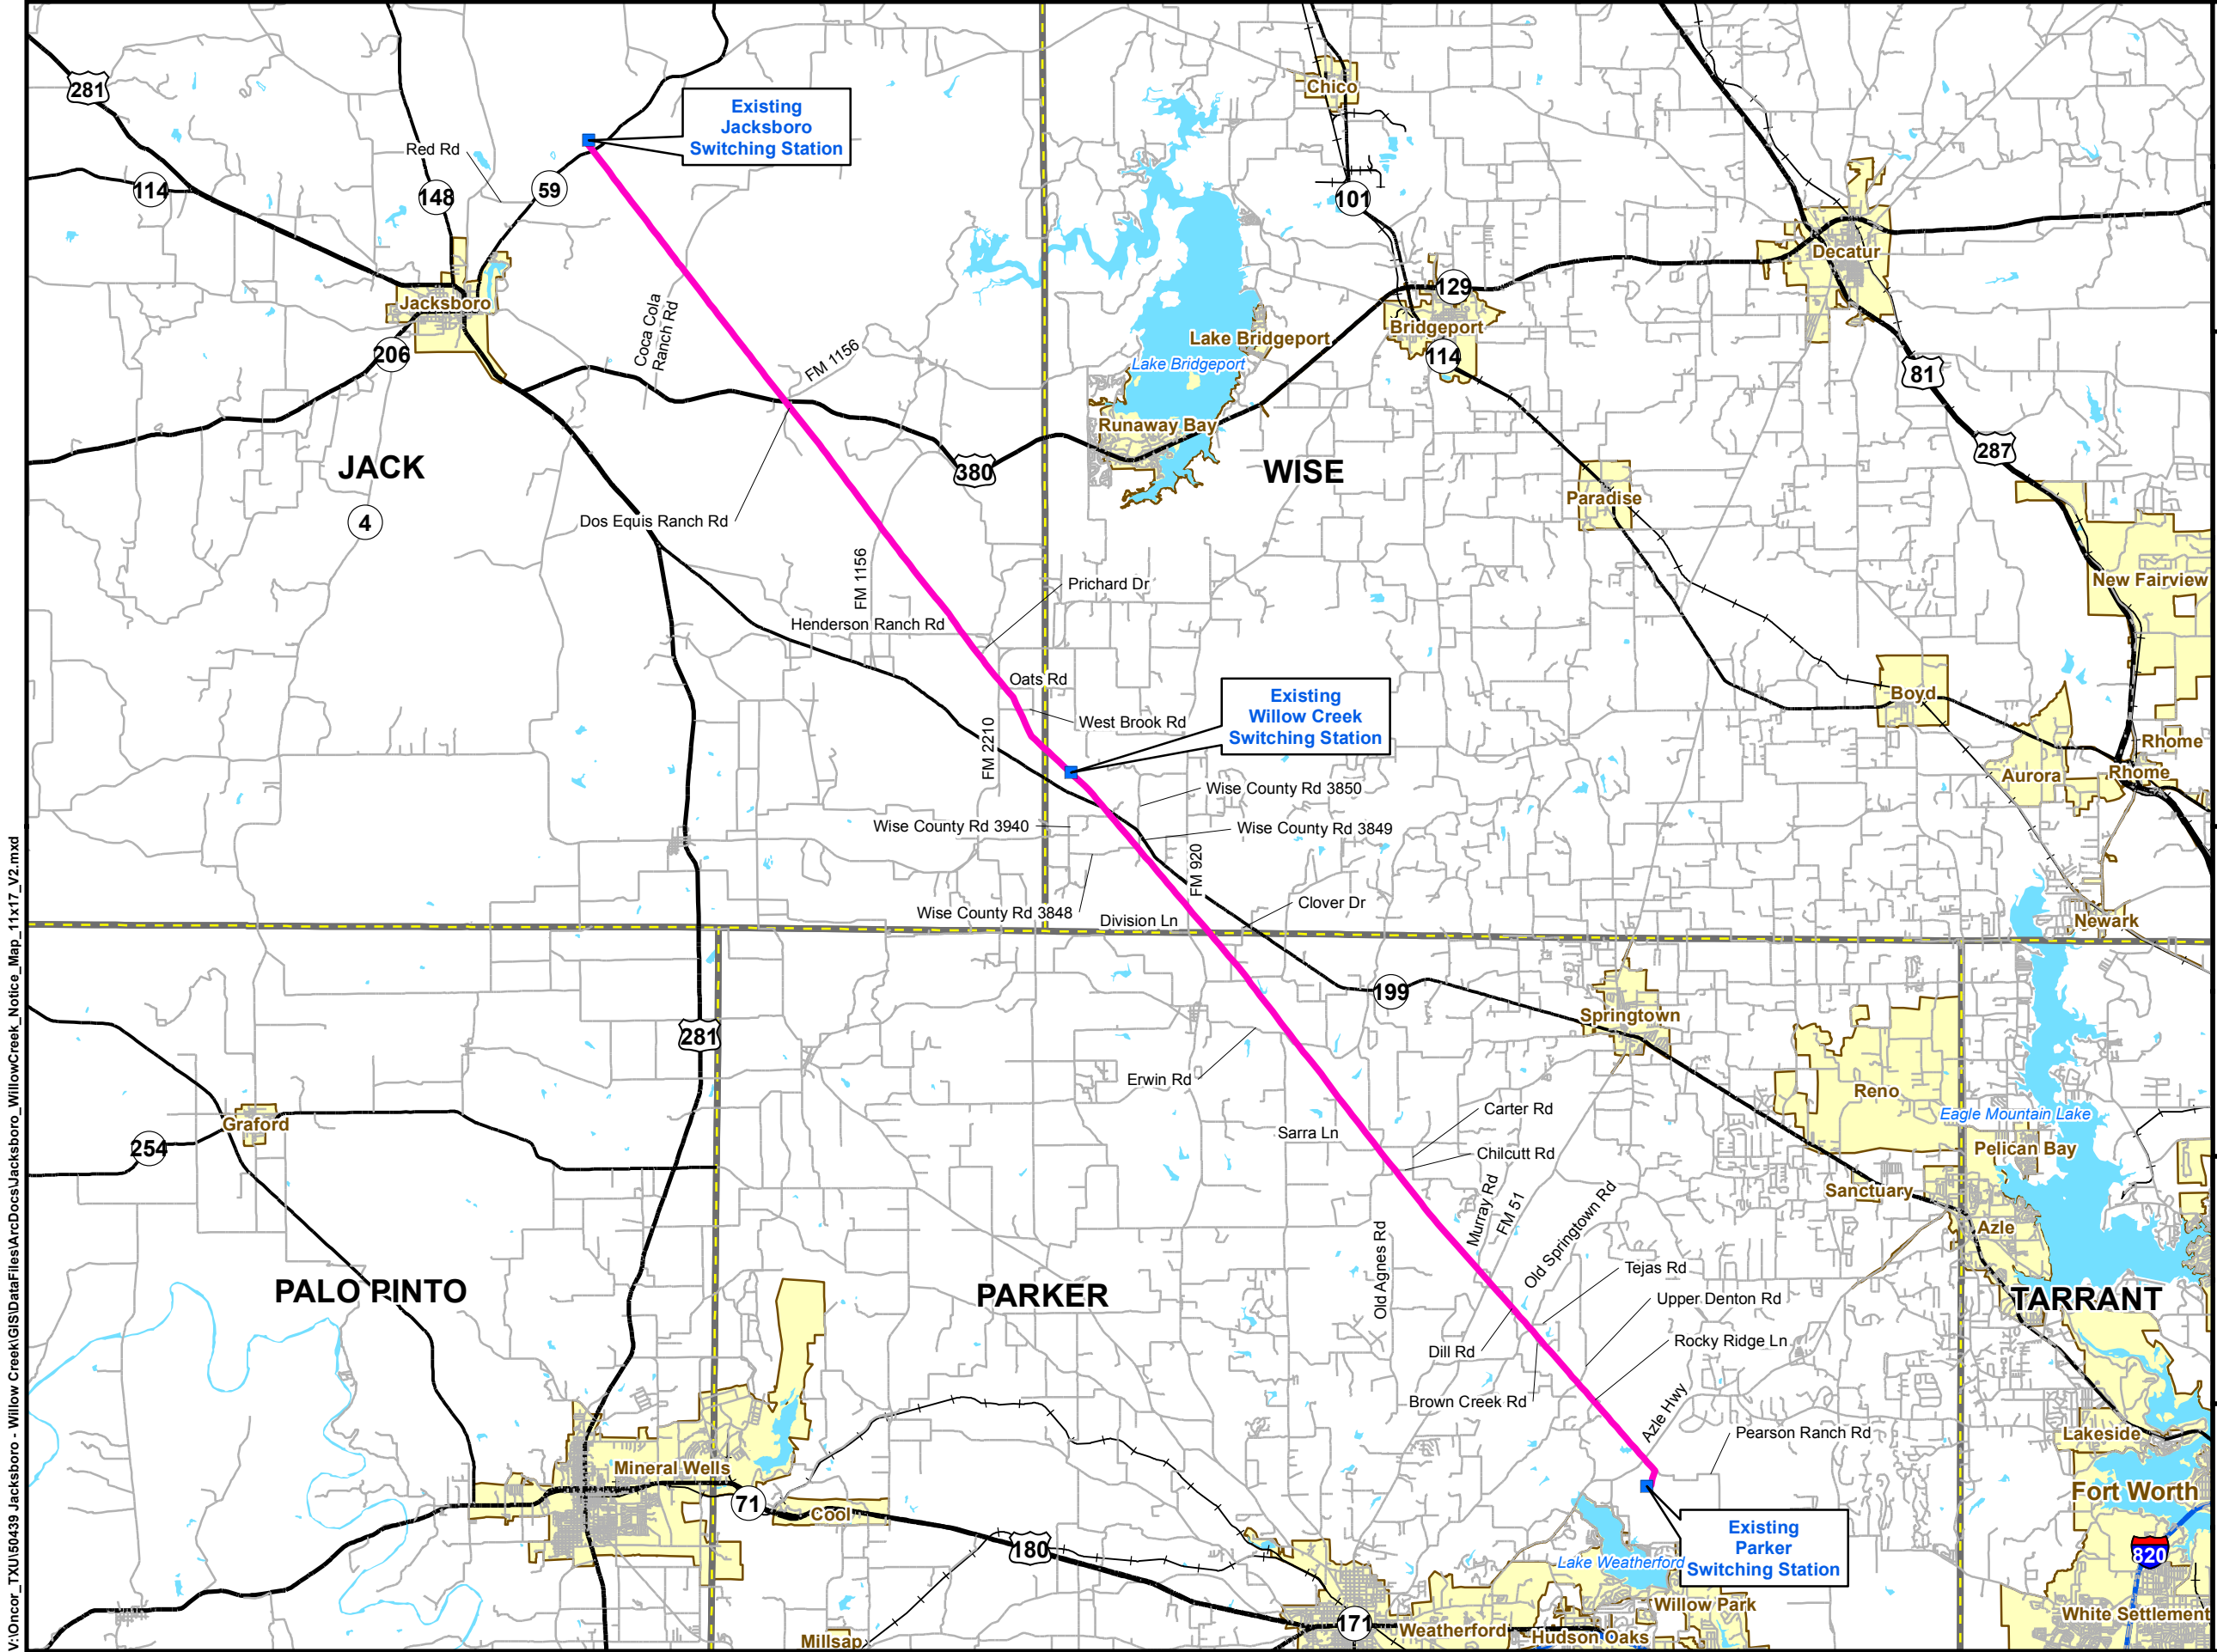

Locator Map

**LEGEND**

- Existing Transmission Line
- Municipal Areas
- County Boundary



Jacksboro - Willow Creek - Parker  
345 kV Transmission Line  
Notice Map

V:\Oncor\_TXU\50439 Jacksboro - Willow Creek\GIS\DataFiles\ArcDocs\Jacksboro\_Notice\_Map\_11x17\_V2.mxd

Source: Texas Natural Resources Information System; ESRI Data.

## **Oncor Electric Delivery Company LLC's Proposed Jacksboro to Willow Creek to Parker 345 kV Transmission Line**

The proposed transmission line project includes the replacement of an existing single circuit 345 kV transmission line. The proposed 41-mile long double circuit 345 kV transmission line is to be constructed along the centerline of the existing single circuit Jacksboro - Willow Creek - Parker 345 kV transmission line, within the existing 150 ft wide transmission line right-of-way. Prior to construction of the proposed double circuit transmission line, the existing single circuit line will be removed.

The proposed transmission line begins at the existing Oncor Electric Delivery Company LLC's Jacksboro Switching Station located approximately 1,070 feet northwest of State Highway (SH) 59, approximately five miles northeast of the intersection of SH 59 and U.S. Highway 281, in Jack County, Texas. From the Jacksboro Switching Station, the proposed line extends in a southeasterly direction for approximately 1,070 feet to a point that is directly northwest of SH 59 and approximately 10,260 feet northeast from the intersection of SH 59 and Red Road.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 18,980 feet to a point located directly west of Coca Cola Ranch Road and approximately 16,125 feet north of the intersection of Coca Cola Ranch Road and U.S. Highway 380. This segment of the proposed transmission line will cross SH 59 and several unnamed roads.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 20,905 feet to a point located directly north of U.S. Highway 380 and approximately 805 feet west of the intersection of U.S. Highway 380 and Dos Equis Ranch Road. This segment of the proposed transmission line will cross Coca Cola Ranch Road, Farm-to-Market Road (FM) 1156, and several unnamed roads.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 20,005 feet to a point located directly west of FM 1156 and approximately 13,855 feet southwest of the intersection of U.S. Highway 380 and FM 1156. This segment of the proposed transmission line will cross U.S. Highway 380 and several unnamed roads.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 16,990 feet to a point located directly north of Henderson Ranch Road and approximately 11,465 feet east of the intersection of Henderson Ranch Road and FM 1156. This segment of the proposed transmission line will cross FM 1156 and several unnamed roads.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 7,380 feet to a point located directly west of FM 2210 and approximately 1,065 feet north of the intersection of FM 2210 and Oats Road. This segment of the

proposed transmission line will cross Henderson Ranch Road, Prichard Drive, and several unnamed roads.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 2,890 feet to a slight angle point. This segment of the proposed transmission line will cross FM 2210 and Oats Road.

From this angle point, the proposed transmission line turns in a south/southeasterly direction for approximately 1,650 feet to a point located directly north of West Brook Road and approximately 2,465 feet east of the intersection of West Brook Road and FM 2210.

From this point, the proposed transmission line continues in a south/southeasterly direction for approximately 3,755 feet to a slight angle point.

From this angle point, the proposed transmission line turns slightly in a southeasterly direction for approximately 6,760 feet to the existing Oncor Electric Delivery Company LLC's Willow Creek Switching Station, in Wise County, Texas. The Willow Creek Switching Station is located approximately 9,950 feet east of the intersection of FM 2210 and SH 199 and 17,800 feet northwest of the intersection of County Road 3940 and SH 199. This segment of the proposed transmission line will cross the Jack County and Wise County line and will cross several unnamed roads.

From the Willow Creek Switching Station, the proposed transmission line continues in a southeasterly direction for approximately 5,850 feet to a point located directly north of SH 199 and approximately 5,680 feet northwest of the intersection of SH 199 and Wise County Road 3850.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 7,600 feet to a point located approximately 250 feet south of the intersection of Wise County Road 3849 and Wise County Road 3848. This segment of the proposed transmission line will cross SH 199, Wise County Road 3940 and Wise County Road 3848.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 9,400 feet to a point located directly west of FM 920 and approximately 3,000 feet north of the intersection of FM 920 and Division Lane.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 38,250 feet to a point located directly north of Sarra Lane and approximately 4,195 feet west of the intersection of Sarra Lane and Carter Road. This segment of the proposed transmission line will cross FM 920, Clover Drive, and Erwin Road.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 22,030 feet to a point directly northwest of FM 51 and approximately 780

feet north of the intersection of FM 51 and Dill Road. This segment of the proposed transmission line will cross Sarra Lane, Old Agnes Road, Chilcutt Road and Murray Road.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 7,930 feet to a point directly northwest of Old Springtown Road and approximately 630 feet south of the intersection of Old Springtown Road and Tejas Road. This segment of the proposed transmission line will cross FM 51 and Dill Road.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 21,780 feet to a point located directly northwest of Azle Highway and approximately 270 feet southwest of the intersection of Azle Highway and Pearson Ranch Road. This segment of the proposed transmission line will cross Old Springtown Road, Brown Creek Road, Upper Denton Road, Rocky Ridge Lane, and Azle Highway.

From this point, the proposed transmission line continues in a southeasterly direction for approximately 2,090 feet to an angle point located directly west of Pearson Ranch Road and approximately 2,220 feet southeast of Azle Highway.

From this angle point, the proposed transmission line turns in a southerly direction for approximately 1,500 feet to the existing Oncor Electric Delivery Company LLC's Parker Switching Station, in Parker County, Texas. The Parker Switching Station is located approximately 3,750 feet south of the intersection of Azle Highway and Pearson Ranch Road. The estimated cost for the proposed transmission line project is \$53,800,000.