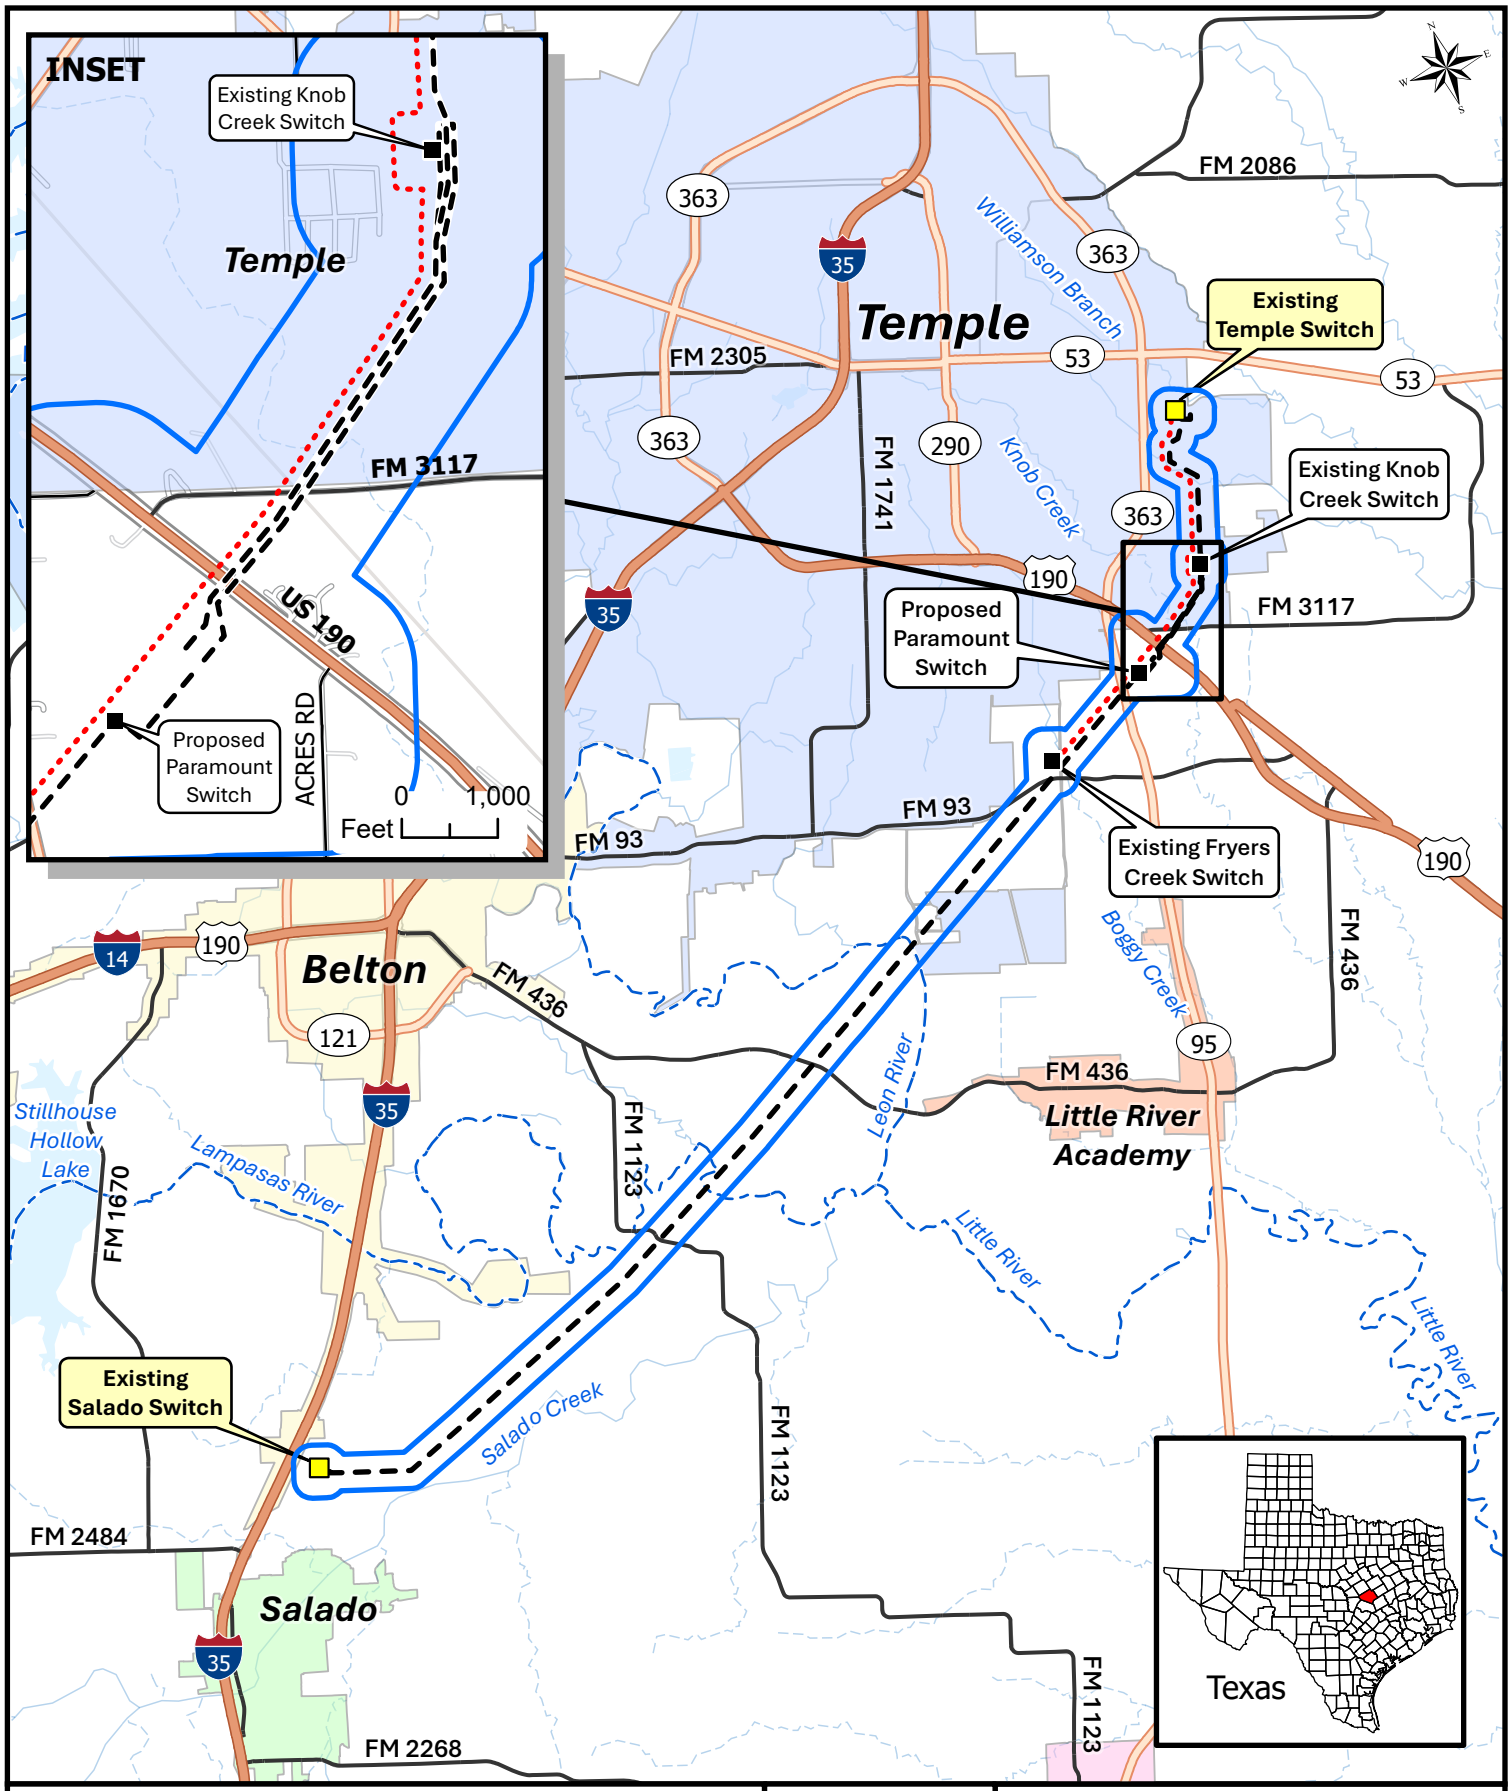

Project Endpoint
Other Transmission Facility
Temple to Fryers Creek 138 kV Circuit
Temple to Salado 345 kV Circuits
Study Area
Municipal Boundary
US or Interstate Highway
State Highway
Farm-to-Market Road
River
0 1 2
Miles

ONCOR
BURNS McDONNELL

Exhibit 1
Project Location Map
Temple Switch to Salado Switch
345/138 kV Transmission Line Project

Source: TxDOT (2026).

Issued: 7/16/2026